


PROVIDE 3
FLUTES @ 300mm
SPACING
(SEE NOTE 5)

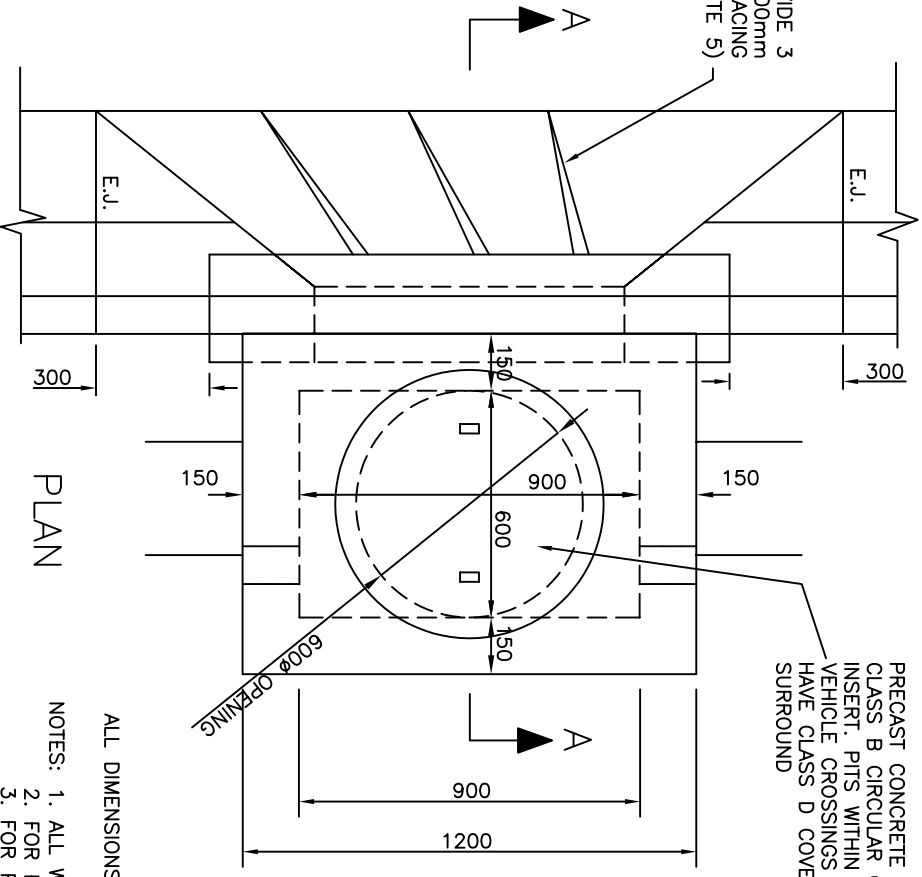


PRECAST CONCRETE COVER WITH
CLASS B CIRCULAR CAST IRON
INSERT. PITS WITHIN 1m OF
VEHICLE CROSSINGS ARE TO
HAVE CLASS D COVER &
SURROUND

PLAN

ALL DIMENSIONS IN MILLIMETRES.

- NOTES:
1. ALL WALLS TO BE 150mm THICK.
 2. FOR PRECAST CONCRETE LINTEL DETAILS REFER TO STD. DWG. SD270
 3. FOR PRECAST CONCRETE COVER DETAILS REFER TO STD. DWG. SD275
 4. THE TOP OF THE PIT SHALL MATCH THE NATURE STRIP CROSSFALL
 5. FLUTES TO BE PROVIDED TO PITS, WHERE KERB AND CHANNEL GRADE EXCEEDS 2%
 6. PIT TO BE HAUNCHED FOR PIPE DIAMETER GREATER THAN 450mm OR DEPTH EXCEEDING 2.0m, REFER TO STD. DWG. SD245
 7. PROVIDE STEP IRONS FOR PIT DEPTH EXCEEDING 1.0m, REFER TO STD. DWG. SD280.
 8. CONCRETE STRENGTH 25Mpa AT 28 DAYS
 9. EXPANSION JOINTS TO BE INSTALLED EITHER SIDE OF PIT WITH 3 No. 450mm LONG R16 BARS GREASED OR SLEEVED ONE END.

RESTRICTED USE ONLY.
GENERALLY ONLY USED FOR
RECONSTRUCTION WORKS.
ONLY TO BE USED IN SPECIAL CASES.

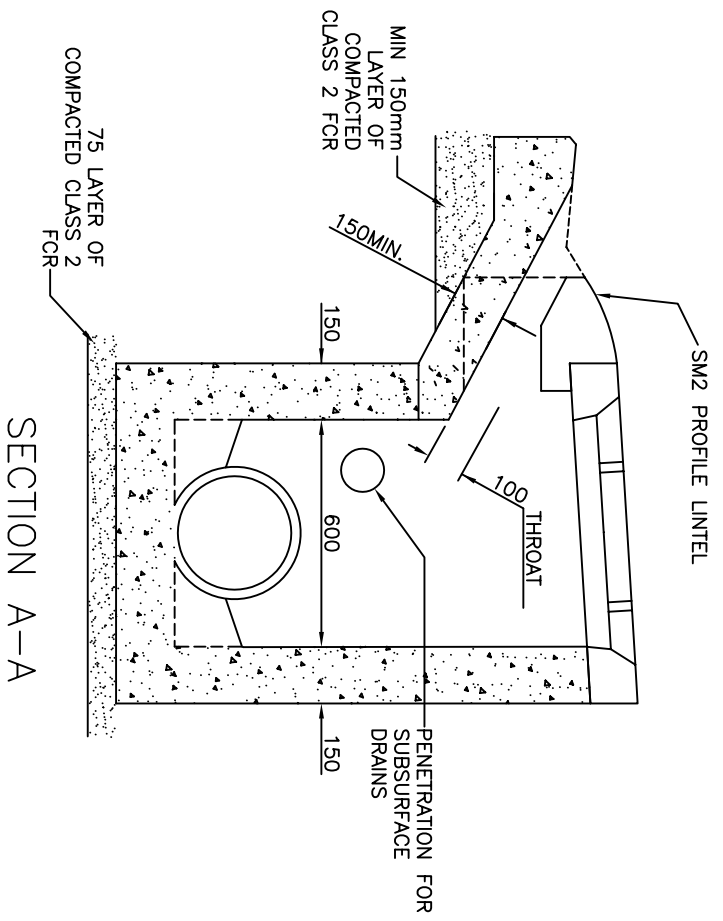

SECTION A-A

Initials	Date	DRAWN :	S. GUCH
R.C.	JAN 05	CHECKED :	R. DEVAPURA
		APPROVED :	S. PLATER
		SCALE :	
		ISSUE DATE:	JUNE 2004

P.O. Box 119
1079 Pascoe Vale Road
Brooklands
Victoria 3047
Telephone (03) 9205 2200
Facsimile (03) 9309 0109

SIDE ENTRY PIT
SEMI MOUNTABLE KERB & CHANNEL
DRAWING NO: SD205