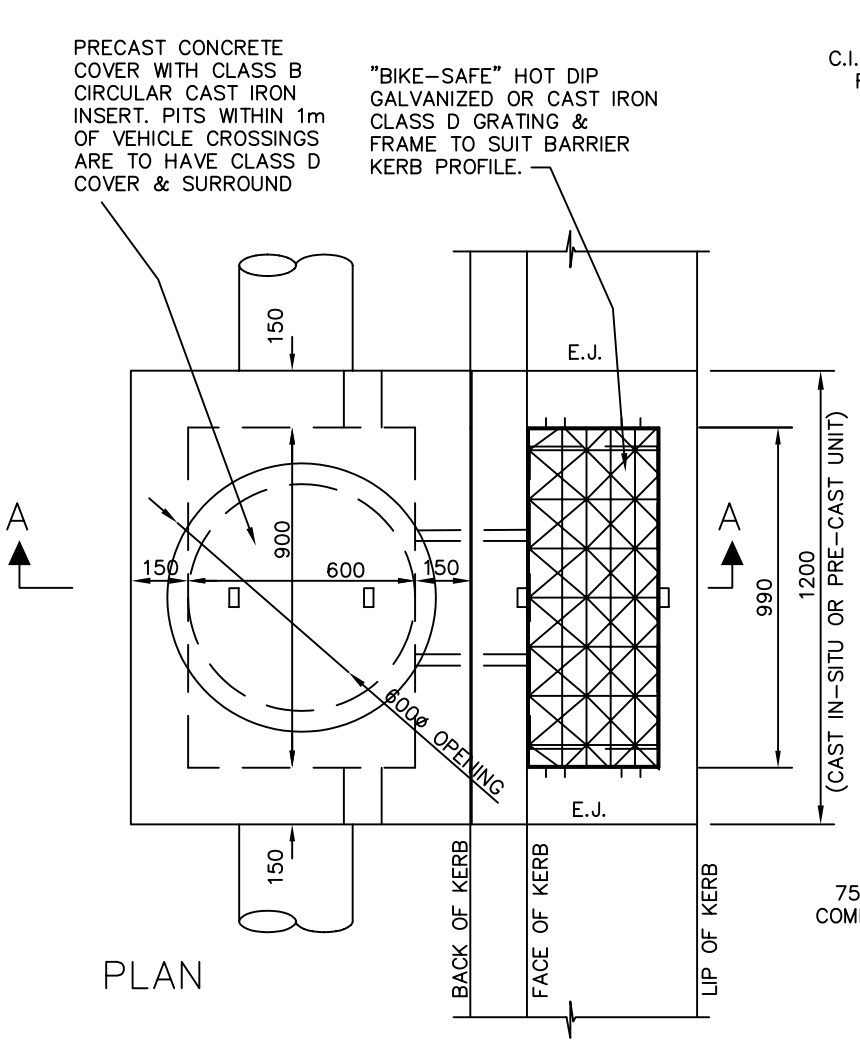

PLAN

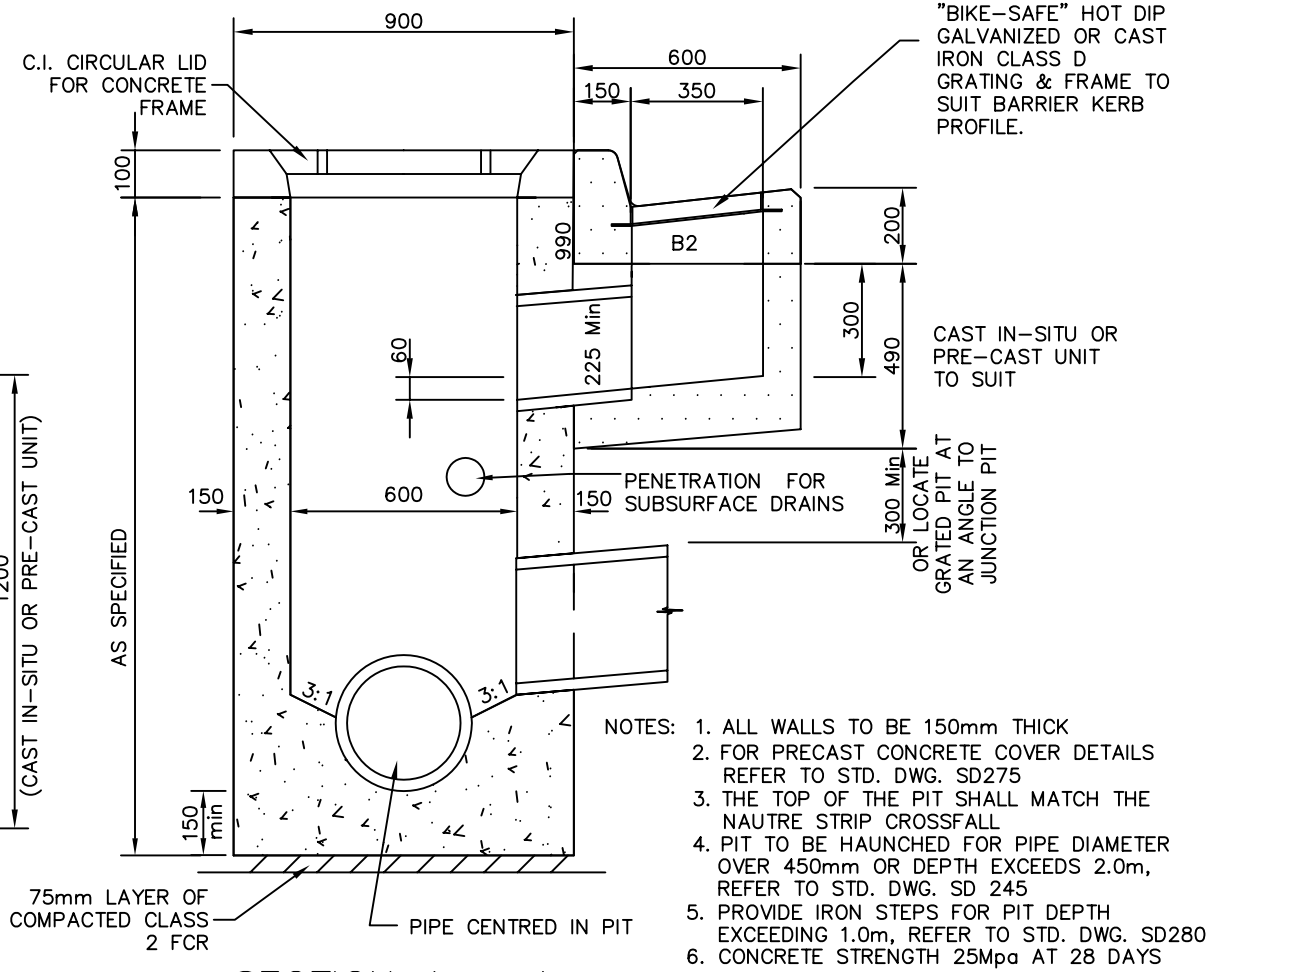

SECTION A – A

NOTES:
1. ALL WALLS TO BE 150mm THICK
2. FOR PRECAST CONCRETE COVER DETAILS REFER TO STD. DWG. SD275
3. THE TOP OF THE PIT SHALL MATCH THE NAUTRE STRIP CROSSFALL
4. PIT TO BE HAUNCHED FOR PIPE DIAMETER OVER 450mm OR DEPTH EXCEEDS 2.0m, REFER TO STD. DWG. SD 245
5. PROVIDE IRON STEPS FOR PIT DEPTH EXCEEDING 1.0m, REFER TO STD. DWG. SD280
6. CONCRETE STRENGTH 25Mpa AT 28 DAYS
7. FOR GRATE DETAIL SEE STD. DWG. SD276
8. EXPANSION JOINTS TO BE INSTALLED EITHER SIDE OF GRATED PITS WITH 3 No. 450mm LONG R16 BARS GREASED OR SLEEVED ONE END.

	Initials	Date
NOTE No.8 ADDED.	R.C.	JAN 05

DRAWN : S. ADAMS
CHECKED : R. DEVAPURA
APPROVED : S. PLATER
SCALE : 1:20
DATE: JUNE 2004

HUME CITY COUNCIL
PO Box 119
1079 Pascoe Vale Road
Broadmeadows
Victoria 3047
Telephone
03) 9205 2200
Facsimile
03) 9309 0109

CHANNEL GRATED PIT
B2 KERB & CHANNEL

DRAWING NO: SD210