


NOTES:

1. ALL WALLS TO BE 150mm THICK
2. FOR PRECAST CONCRETE COVER DETAILS REFER TO STD. DWG. SD275
3. THE TOP OF THE PIT SHALL MATCH THE NAUTRE STRIP CROSSFALL
4. PIT TO BE HAUNCHED FOR PIPE DIAMETER OVER 450mm OR DEPTH EXCEEDS 2.0m, REFER TO STD. DWG. SD 245
5. PROVIDE IRON STEPS FOR PIT DEPTH EXCEEDING 1.0m, REFER TO STD. DWG. SD280
6. CONCRETE STRENGTH 25MPa AT 28 DAYS
7. FOR GRATE DETAIL SEE STD. DWG. SD276
8. EXPANSION JOINTS TO BE INSTALLED EITHER SIDE OF GRATED PITS WITH 3 No. 450mm LONG R16 BARS GREASED OR SLEEVED ONE END.

Initials	Date

DRAWN : R.CHARTERS
 CHECKED : J.DAVIS
 APPROVED : J.DAVIS
 SCALE : 1:20
 DATE: NOV 2007

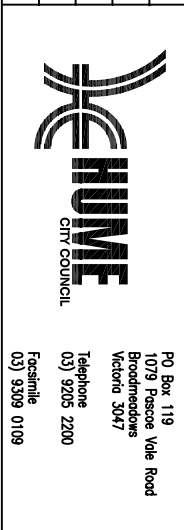

DRAWING NO: SD2111
 DOUBLE CHANNEL GRATED PIT
 B2 KERB & CHANNEL