



OUTLET SECTION

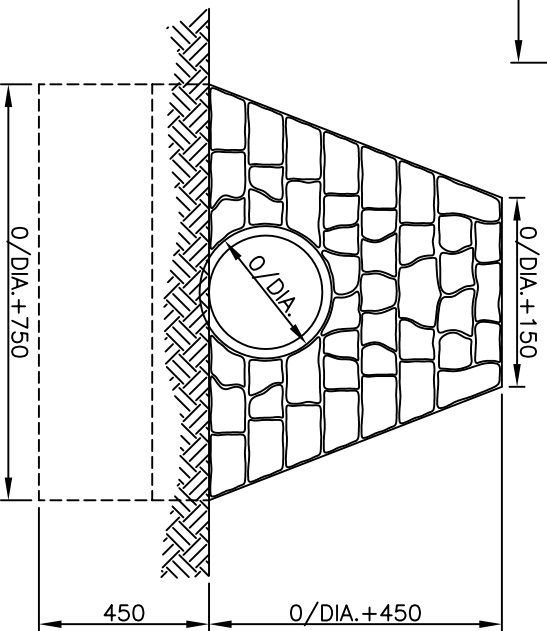

INLET AND OUTLET END ELEVATION

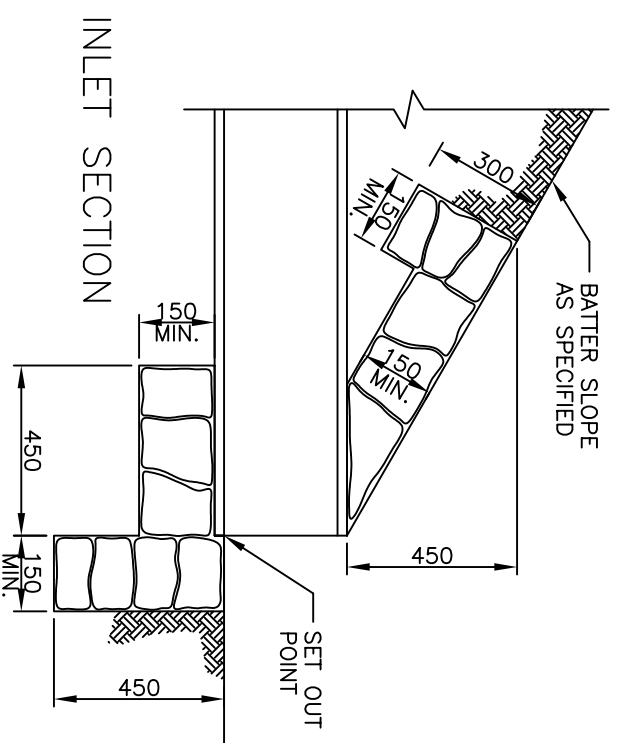

INLET SECTION

NOTES:

1. ROCKS SHALL BE SOUND, DENSE AND RESISTANT TO WEATHERING.
2. UNLESS USED FOR FILLING IN, ROCK SHALL WEIGH BETWEEN 20 AND 70 kg WITH 60% WEIGHING AT LEAST 40 kg.
3. GROUT SHALL BE 1 PART CEMENT TO 3 PARTS FINE SAND MIXED TO A STIFF CONSISTANCY.
4. TOLERANCE ON ROCKS 50mm DEVIATION.

Amendments	
No.	Detail
A	

DRAWN : D. SALAZAR
 CHECKED : R. DEVAPURA
 APPROVED : S. PLATER
 SCALE : 1 : 20
 ISSUE DATE: JUNE 2004



P.O. Box 119
 1079 Pascoe Vale Road
 Broadmeadows
 Victoria 3047
 Telephone
 (03) 9205 2200
 Facsimile
 (03) 9309 0109

TYPE :
 GROUTED MASONRY ENDWALL

DRAWING NO.:
 SD255