


PLAN

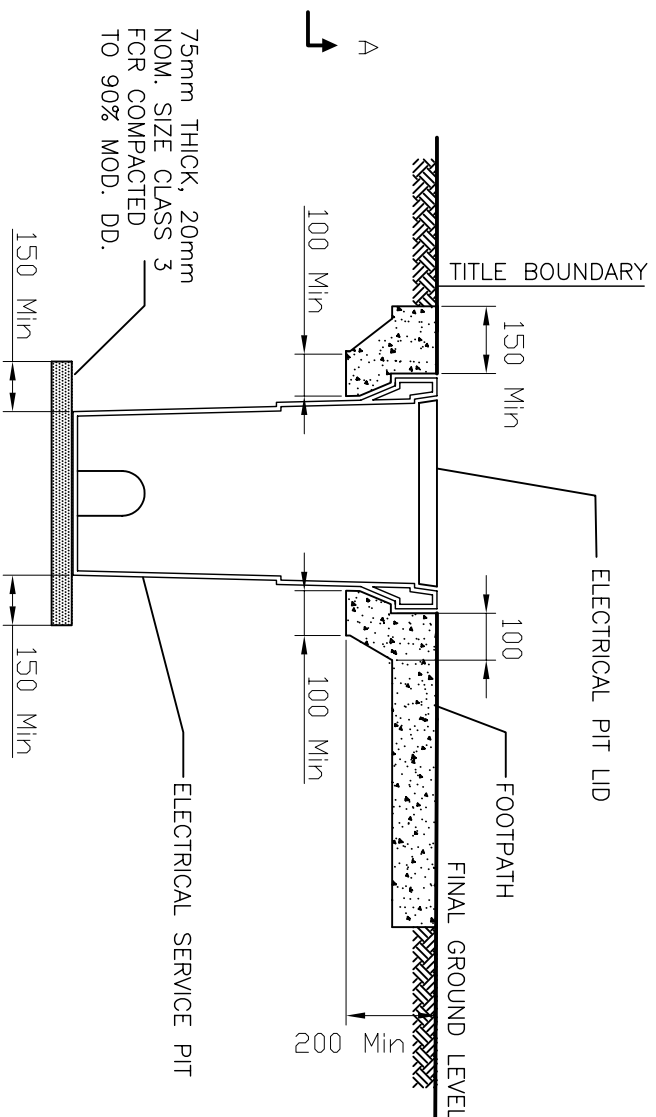


SECTION A-A

NOTES:

1. WHERE THE SERVICE PIT IS SITUATED IN THE FOOTPATH, IT IS TO BE INSTALLED WITH ITS OUTER EDGE NOT LESS THAN 150mm FROM THE EDGE OF THE FOOTPATH.
2. THE FOOTPATH IS TO BE THICKENED A MIN OF 200mm TO FORM A CONCRETE COLLAR USED TO SUPPORT THE PIT.
3. SEWER & TELECOM PITS ARE TO BE TREATED IN A SIMILAR MANNER. WRAP EXPANSION FOAM AROUND SEWER MANHOLES IN FOOTPATHS.
4. CONCRETE STRENGTH 25mpa AT 28 DAYS
5. ALL DIMENSIONS ARE IN MILLIMETRES

Amendments			
No.	Zone	Detail	Date

DRAWN : R. CHARTERS  
 CHECKED : R. DEVAPURA  
 APPROVED : S. PLATER  
 SCALE : N.T.S  
 ISSUE DATE: JUNE 2004

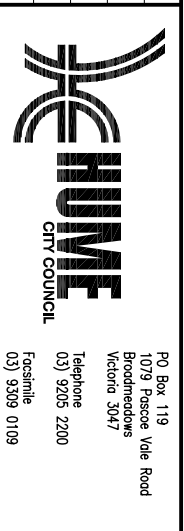

TYPE :  
**ELECTRICAL PITS IN FOOTPATHS**

DRAWING NO:  
**SD309**

P.O. Box 119  
 1079 Pascoe Vale Road  
 Broadmeadows  
 Victoria 3047  
 Telephone  
 (03) 9205 2200  
 Facsimile  
 (03) 9309 0109