



ELEVATION

NOTES:

1. ALL PROPERTY CONNECTION PIPES AND FITTINGS TO BE OF MIN. 100Ø mm PVC SEWER CLASS SN6, REFER AS 1260.
2. ALL PVC JOINTS TO BE SEALED WITH SOLVENT CEMENT OR RUBBER RING JOINTS.
3. DEPTH 'D' = 400mm MINIMUM UNLESS APPROVED BY COUNCIL.
4. BACKFILL AROUND RISER PIPE WITH CLASS 3 CRUSHED ROCK OR CLASS 3 CRUSHED CONCRETE.
5. BED PROPERTY CONNECTION PIPE ON 50mm COMPACTED 20mm CLASS 3 CRUSHED ROCK OR CLASS 3 CRUSHED CONCRETE.
6. BACKFILL TRENCH WITH CLASS 3 20mm CRUSHED ROCK OR CLASS 3 20mm CRUSHED CONCRETE TO 100mm ABOVE THE PROPERTY CONNECTION IN EASEMENTS AND UNPAVED AREAS AND TO SUBGRADE LEVEL UNDER FOOTPATHS AND PAVED AREAS.
7. ALL DIMENSIONS IN mm OR AS NOTED OTHERWISE.
8. FOR DRAINS LESS THAN 750mm COVER, REFER SD293.
9. NOT APPLICABLE TO MELBOURNE WATER CORPORATION DRAINAGE ASSETS. FOR MWC WORKS REFER TO MWC LAND DEVELOPMENT MANUAL.

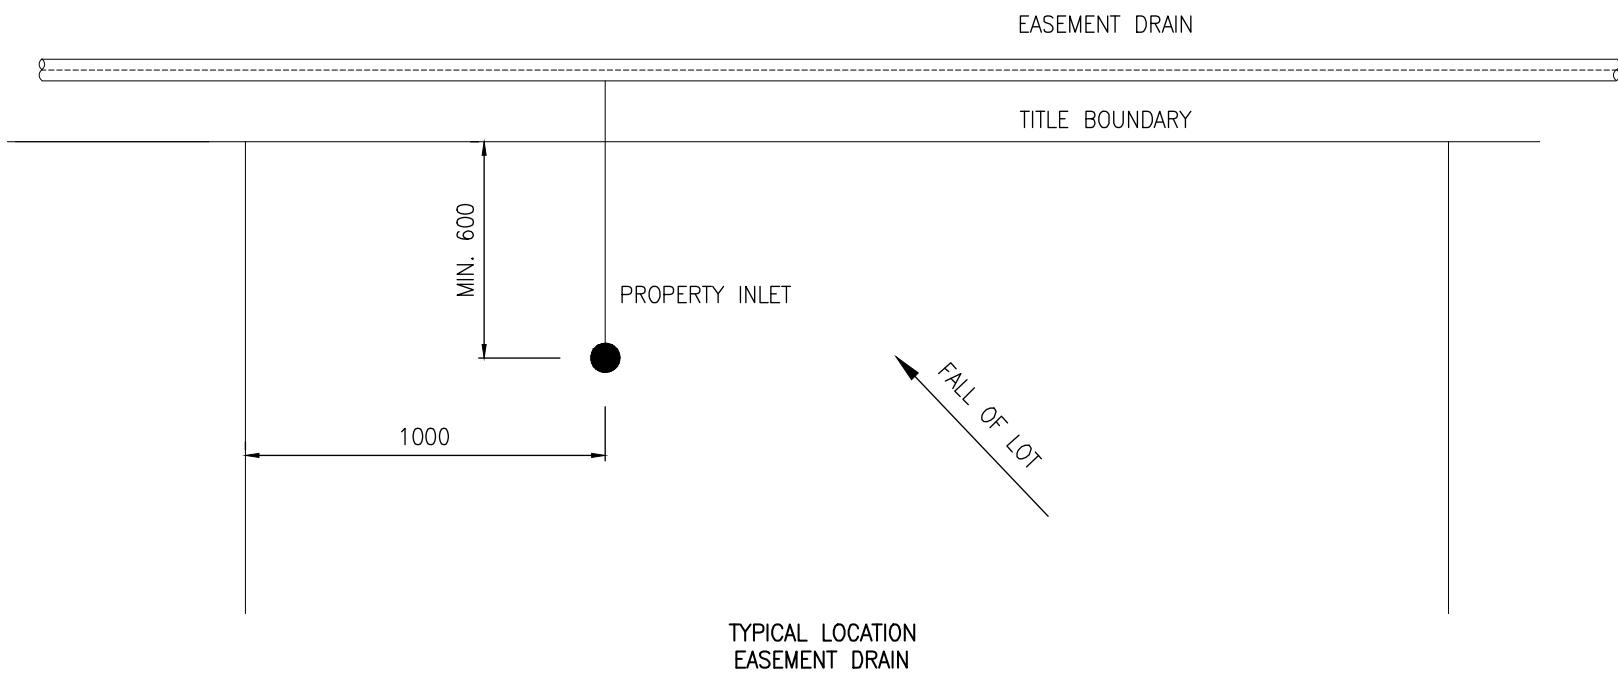

TYPICAL LOCATION  
EASEMENT DRAIN

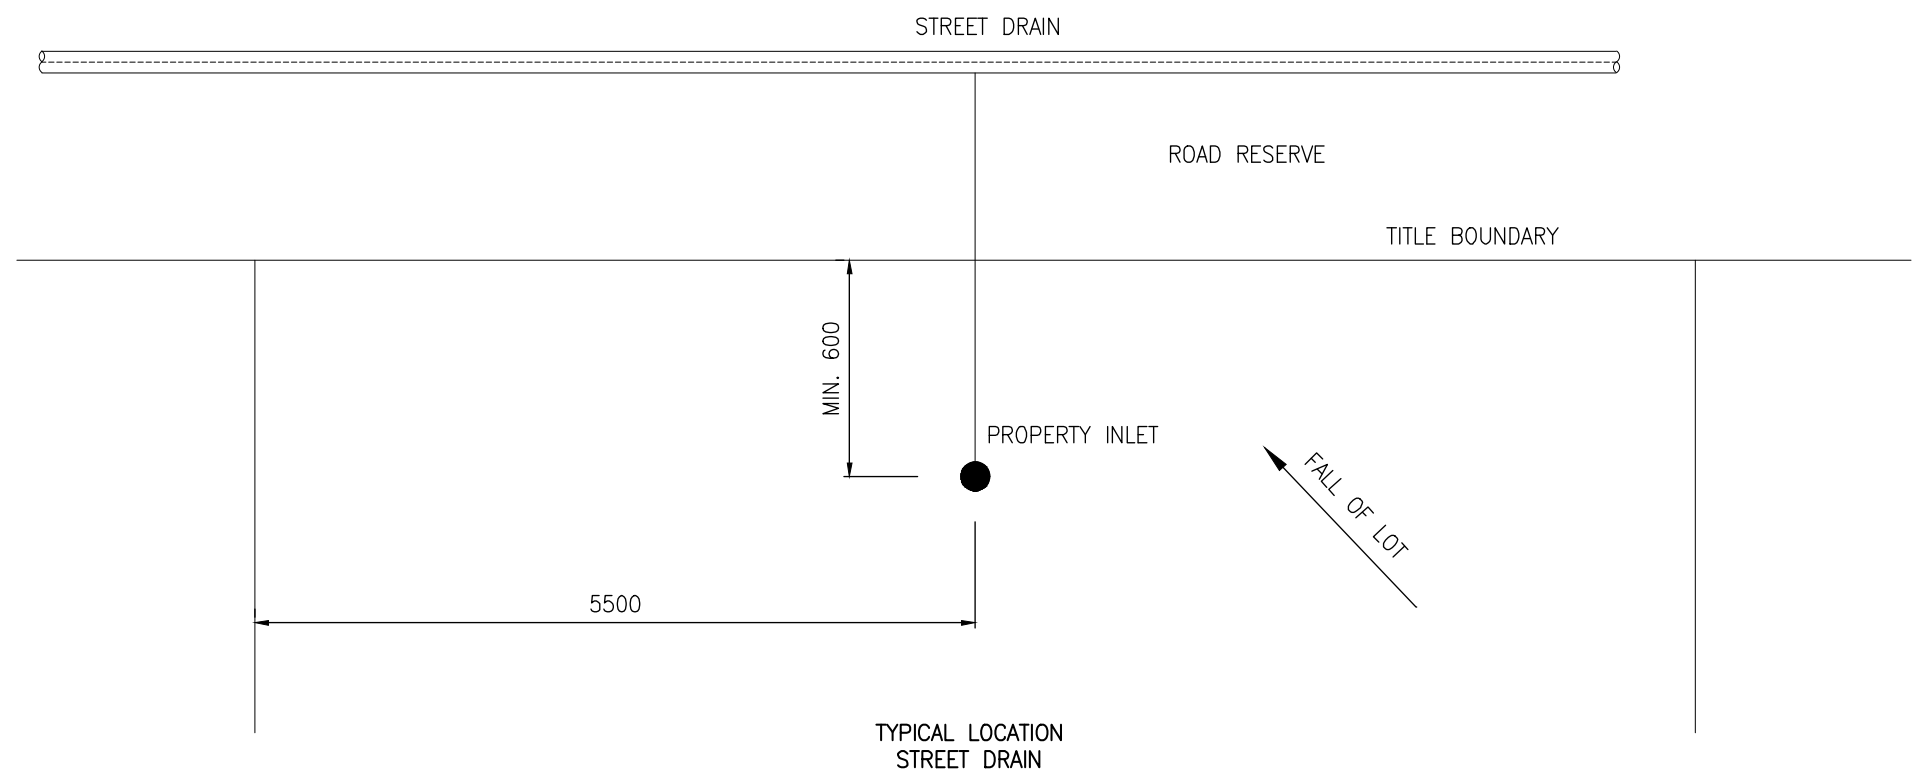


TYPICAL LOCATION  
STREET DRAIN

PROPERTY INLET – DRAIN IN LAND ABUTTING PROPERTY

N.T.S.

ALL DIMENSIONS IN mm

NOT TO SCALE

AMENDMENTS					PROPERTY INLET DRAIN IN LAND ABUTTING PROPERTY	
DATE	DETAILS	INITIALS				
MAY 2025	HUME STANDARDS UPDATE	N.H			VERSION: A	DRAWING NO: SD290