


PLAN

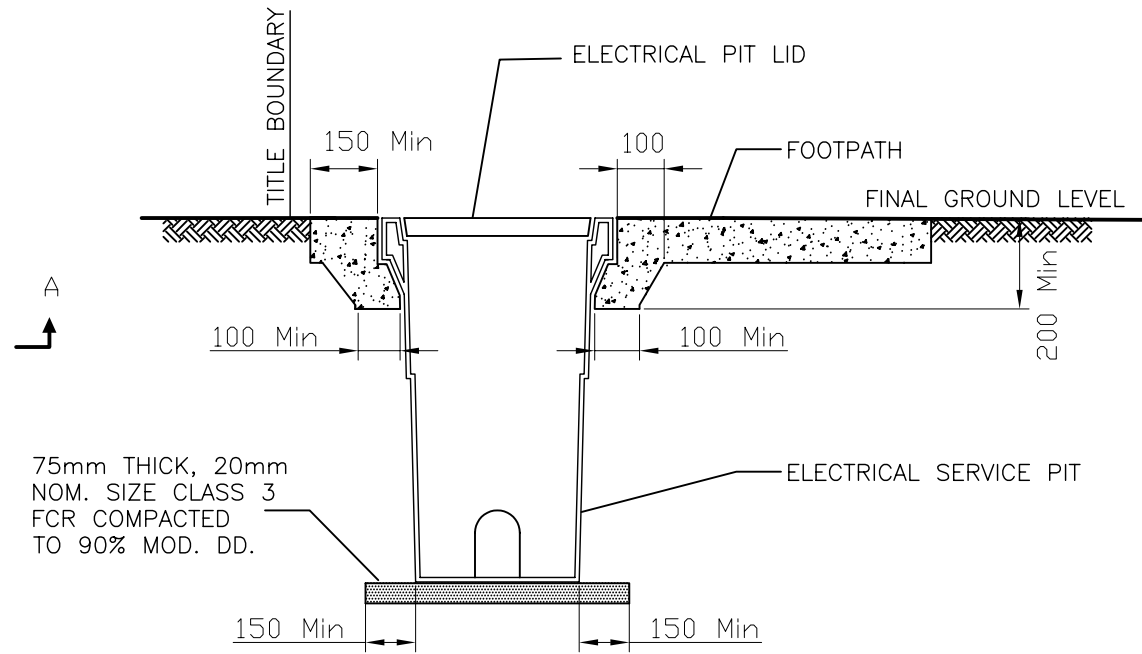

SECTION A-A

75mm THICK, 20mm
NOM. SIZE CLASS 3
FCR COMPACTED
TO 90% MOD. DD.

NOTES:

1. WHERE THE SERVICE PIT IS SITUATED IN THE FOOTPATH, IT IS TO BE INSTALLED WITH ITS OUTER EDGE NOT LESS THAN 150mm FROM THE EDGE OF THE FOOTPATH.
2. THE FOOTPATH IS TO BE THICKENED A MIN OF 200mm TO FORM A CONCRETE COLLAR USED TO SUPPORT THE PIT.
3. SEWER & TELECOM PITS ARE TO BE TREATED IN A SIMILAR MANNER. WRAP EXPANSION FOAM AROUND SEWER MANHOLES IN FOOTPATHS.
4. CONCRETE STRENGTH 25Mpa AT 28 DAYS
5. ALL DIMENSIONS ARE IN MILLIMETRES

Amendments				
No.	Zone	Detail	Initials	Date

DRAWN : R. CHARTERS
 CHECKED : R. DEVAPURA
 APPROVED : S. PLATER
 SCALE : N.T.S
 ISSUE DATE: JUNE 2004



P.O. Box 119
 1079 Pascoe Vale Road
 Broadmeadows
 Victoria 3047

Telephone
 03) 9205 2200

Facsimile
 03) 9309 0109

TYPE :

ELECTRICAL PITS IN FOOTPATHS

DRAWING NO:

SD309